

Laboratory for Acoustics



Determination of the sound absorption (reverberation room method) of wall and ceiling panels type Echoshape, manufacturer Beterplast



Laboratory for Acoustics

Determination of the sound absorption (reverberation room method) of wall and ceiling panels type Echoshape, manufacturer Beterplast

Principal	Beterplast Plastic Industries Ltd
Report number	A 3740-3E-RA-002
Date	5 October 2020
Reference	TS/TS/HT/A 3740-3E-RA-002
Representative	Th.W. Scheers
Author	Th.W. Scheers +31858228647 t.scheers@peutz.nl

peutz bv, postbus 66, 6585 zh mook, +31 85 822 86 00, info@peutz.nl, www.peutz.nl

All orders are accepted and executed according to 'De Nieuwe Regeling 2011' (The New Rules)

BTW NL004933837B01 KvK: 12028033

mook – zoetermeer – groningen – eindhoven – düsseldorf – dortmund – berlijn – leuven – parijs – lyon

Table of contents

1	Introduction	4
2	Standards and guidelines	5
3	Tested construction	6
4	Measurements	7
4.1	Method	7
4.2	Accuracy	8
4.3	Environmental conditions during the measurements	9
4.4	Results	9

1 Introduction

At the request of Beterplast LTD based in Kiryat Ata (ISRAEL), laboratory measurements of the sound absorption (reverberation room method) were carried out on:

**wall and ceiling panels type Echoshape,
manufacturer Beterplast**

in the Laboratory for Acoustics of Peutz bv, at Mook, the Netherlands (see figure 1).



For these type of measurements the Laboratory for Acoustics has been accredited by the Dutch Accreditation Council (RvA).

The RvA is member of the EA MLA (**EA MLA: European Accreditation Organisation MultiLateral Agreement**: <http://www.european-accreditation.org>).

EA: "Certificates and reports issued by bodies accredited by MLA and MRA members are considered to have the same degree of credibility, and are accepted in MLA and MRA countries."

2 Standards and guidelines

The measurements have been carried out according to the Quality Manual of the Laboratory for Acoustics as well as:

ISO 354:2003 ¹ Acoustics Measurement of sound absorption in a reverberation room
NOTE: this international standard has been accepted within all EU-countries
 as European standard EN ISO 354:2003

Various other related norms:

EN ISO 11654:1997 Acoustics Sound absorbers for use in buildings Rating of sound
 absorption

ASTM C423-17 Standard Test Method for Sound Absorption and Sound Absorption
 Coefficients by the Reverberation Room Method

¹ According to this norm, the report should include for each measurement the mean reverberation times T_1 and T_2 at each frequency. Because these figures are not relevant for judging the quality of the product being tested, but merely for judging the accuracy of the calculations, they have been omitted in this report. It is possible of course to reproduce those figures at any time if the principal requests this.

3 Tested construction

The data presented here were taken from the information supplied by the principal. The density of the materials as reported is derived from the actual weighing by the laboratory staff of the materials under test.

The following wall panels have been tested.

Type	Echoshape	
Manufacturer	Beterplast	
Material	PET	
Panel sizes:	1200 mm x 400 mm	
Thickness:	9 mm	
Mass:	1,84 kg/m ² (weighted)	

Type	Echoshape	
Manufacturer	Beterplast	
Material	PET	
Panel sizes:	1200 mm x 400 mm	
Thickness:	12 mm	
Mass:	2,33 kg/m ² (weighted)	

Type	Echoshape	
Manufacturer	Beterplast	
Material	PET	
Panel sizes:	1200 mm x 600 mm	
Thickness:	24 mm	
Mass:	3,23 kg/m ² (weighted)	

The results as presented here relate only to the tested items and laboratory conditions as described in this report. The laboratory can make no judgement about the representativity of the tested samples. The test report ahead is valid as long as the tested constructions and/or materials are unchanged.

4 Measurements

The wall panels (see description in chapter 3) are measured in the following measurement set-ups:

1. Airgap 0 mm: The panels have been put directly on the floor of the reverberation room;
2. Airgap 50 mm: The wall panels are mounted on a support structure at a distance of 50 mm above the floor of the reverberation room;
3. Airgap 200 mm: The wall panels are mounted on a support structure at a distance of 200 mm above the floor of the reverberation room.

No suspension-system has been used, the panels were put tight to each other. The sides of the set-up were enclosed by 18 mm thick plastic covered chipwood board and sealed by tape. The measurement setups are according to type A and E mounting method as described in Annex B of ISO 354:2003 (Test specimen mountings for sound absorption tests).

4.1 Method

The tests were conducted in accordance with the provisions of the test method ISO 354 in the reverberation room of "Peutz bv" in Mook (the Netherlands) (see figure 1). The relevant data regarding the reverberation room are given in figure 2 of this report.

By means of reverberation measurements the reverberation time of the room is measured under two conditions:

- when the reverberation room is empty
- when the construction under test is inside the reverberation room

In general, once material is placed into the reverberation room a lower reverberation time will result.

The difference in reverberation times is a measure of the amount of absorption brought into the room.

Measurements and calculations were carried out in 1/3-octave bandwidth from 100 to 5000 Hz, according to the norms. Where applicable the octave values have been calculated from these 1/3-octave values.

From the reverberation measurements in the empty reverberation room the equivalent sound absorption A_1 is calculated (per frequency band) according to formula 1 and expressed in m^2

$$A_1 = \frac{55,3 V}{c T_1} - 4 V m_1 \quad (1)$$

in which:

- V = the volume of the reverberation room [m³]
 T_1 = the reverberation time in the empty reverberation room [sec.]
 m_1 = "power attenuation coefficient" in the empty room,
 calculated according to formula [m⁻¹]
 c = the speed of sound in the air, in m/s, calculated according to [m/s]

$$c = 331 + 0,6t \quad (2)$$

in which:

- t = the temperature; this formula is valid for temperatures between 15 and 30 °C [°C]

$$m = \frac{\alpha}{10 \log(e)} \quad (3)$$

in which:

- α = "attenuation coefficient" according to ISO 9613-1

In the same manner the equivalent sound absorption A_2 for the room with the test specimen is calculated according to formula 4, also expressed in m²

$$A_2 = \frac{55,3V}{cT_2} - 4Vm_2 \quad (4)$$

in which:

c and V have the same definition as in formula 1 and

- T_2 = the reverberation time of the reverberation room with the test specimen placed inside [sec]
 m_2 = "power attenuation coefficient" in the room with the test specimen placed inside, calculated according to formula 3 [m⁻¹]

The equivalent sound absorption A of the test specimen has been calculated according to formula 5 and is expressed in m²

$$A = A_2 - A_1 \quad (5)$$

When the test specimen consists of one plane with an area between 10 and 12 m² the sound absorption coefficient α_s has to be calculated according to formula 6:

$$\alpha = \frac{A}{S} \quad (6)$$

in which:

- S = the area of the test specimen [m²]

4.2 Accuracy

The accuracy of the sound absorption as calculated can be expressed in terms of repeatability (tests within one laboratory) and reproducibility (between various laboratories).

When:

- two tests are performed on identical test material
- within a short period of time
- by the same person or team
- using the same instrumentation
- under unchanged environmental conditions

the probability will be 95% that the difference between the two test results will be less than or equal to r .

In order to evaluate the repeatability r for the sound absorption measurements performed in the reverberation room of "Peutz bv" in Mook (the Netherlands) eight series of measurements have been carried out according to ISO 354:1985 annex C. From the results of those measurements the repeatability r has been calculated. It was found that for the frequency range from 100 to 200 Hz and at 5000 Hz the repeatability r is 0,21 as a maximum. For the frequency range 250 to 4000 Hz the repeatability r is 0,09 as a maximum.

4.3 Environmental conditions during the measurements

t4.1 Environmental conditions during the measurements at June 23th, 2020

reverberation room	temperature [°C]	barometric pressure [kPa]	relative humidity [%]
empty	21,6	102,3	52,3
variant 1	21,6	102,2	52,7

4.4 Results

The results of the measurements are given in table 4.2, 4.3 and 4.4 as well as in figure 3 to 11. The measurements were made in 1/3-octave bands. The results presented in octave-bands are the arithmetic average of the results of the three 1/3-octave bands belonging to that octaveband. From those values the following one-figure ratings have been calculated and stated :

- the "weighted sound absorption coefficient α_w " according to ISO 11654;
- the "Sound Absorption Average SAA" according to ASTM-C423, being the average of the absorption coefficients (1/3 octave values) at the frequencies of 200 Hz up to 2500 Hz, rounded to the nearest 0,01.

t4.2 Measurement results Echoshape mounted at an airgap of 0 mm

	sound absorption coefficient α_s					
Variant nr.	1		2		3	
record nr.	#161		#124		#73	
Material thickness	9 mm		12 mm		24 mm	
See figure	3		4		5	
frequency [Hz]	1/3 oct.	1/1 oct.	1/3 oct.	1/1 oct.	1/3 oct.	1/1 oct.
100	0,01		0,02		0,03	
125	0,00	0,01	0,01	0,02	0,03	0,05
160	0,03		0,03		0,09	
200	0,03		0,05		0,13	
250	0,04	0,05	0,05	0,07	0,19	0,21
315	0,07		0,11		0,31	
400	0,09		0,15		0,41	
500	0,13	0,13	0,20	0,21	0,49	0,51
630	0,18		0,29		0,63	
800	0,26		0,43		0,71	
1000	0,35	0,35	0,54	0,54	0,81	0,80
1250	0,45		0,65		0,88	
1600	0,55		0,76		0,95	
2000	0,65	0,65	0,83	0,83	0,98	0,97
2500	0,74		0,90		0,98	
3150	0,80		0,94		0,97	
4000	0,89	0,88	0,98	0,98	0,97	0,98
5000	0,95		1,02		1,00	
α_w	0,25(H)		0,25(MH)		0,50(MH)	
SAA	0,30		0,41		0,62	

t4.3 Measurement results Echoshape mounted at an airgap of 50 mm


	sound absorption coefficient α_s					
Variant nr.	4		5		6	
record nr.	#419		#382		#345	
Material thickness	9 mm		12 mm		24 mm	
See figure	6		7		8	
frequency [Hz]	1/3 oct.	1/1 oct.	1/3 oct.	1/1 oct.	1/3 oct.	1/1 oct.
100	0,00		0,02		0,04	
125	0,07	0,06	0,08	0,08	0,11	0,11
160	0,10		0,14		0,18	
200	0,15		0,20		0,26	
250	0,24	0,24	0,30	0,32	0,41	0,41
315	0,34		0,45		0,55	
400	0,48		0,58		0,68	
500	0,60	0,60	0,69	0,70	0,81	0,80
630	0,71		0,82		0,91	
800	0,84		0,91		0,97	
1000	0,91	0,92	0,93	0,95	0,99	0,98
1250	1,00		1,00		0,99	
1600	1,02		0,99		0,98	
2000	1,00	0,98	0,96	0,96	0,97	0,96
2500	0,93		0,92		0,94	
3150	0,87		0,90		0,97	
4000	0,88	0,91	0,95	0,95	0,98	0,99
5000	0,99		1,00		1,01	
α_w	0,55(MH)		0,60(MH)		0,70(MH)	
SAA	0,69		0,73		0,79	

t4.4 Measurement results Echoshape mounted at an airgap of 200 mm


	sound absorption coefficient α_s					
Variant nr.	7		8		9	
record nr.	#234		#271		#308	
Material thickness	9 mm		12 mm		24 mm	
See figure	9		10		11	
frequency [Hz]	1/3 oct.	1/1 oct.	1/3 oct.	1/1 oct.	1/3 oct.	1/1 oct.
100	0,13		0,19		0,14	
125	0,35	0,34	0,42	0,40	0,37	0,36
160	0,53		0,60		0,56	
200	0,57		0,61		0,62	
250	0,74	0,70	0,75	0,74	0,82	0,79
315	0,79		0,87		0,94	
400	0,85		0,87		0,90	
500	0,87	0,87	0,89	0,88	0,93	0,90
630	0,88		0,88		0,87	
800	0,71		0,73		0,77	
1000	0,69	0,74	0,75	0,78	0,81	0,84
1250	0,82		0,87		0,94	
1600	0,86		0,88		0,93	
2000	0,85	0,87	0,91	0,92	0,96	0,96
2500	0,91		0,96		0,99	
3150	0,92		0,96		1,01	
4000	0,91	0,93	0,98	0,98	0,99	1,02
5000	0,96		1,01		1,05	
α_w	0,85		0,90		0,90	
SAA	0,80		0,83		0,87	

The sound absorption coefficient of a material is not a material property. It should be taken into account that the sound absorption of a construction depends on the dimensions, the way of mounting of the material and its position in the room.

Mook,

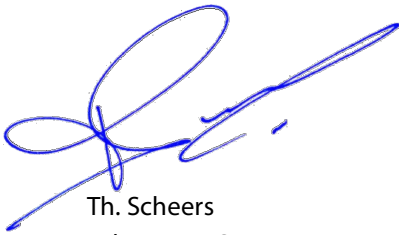

Th. Scheers
Laboratory Supervisor

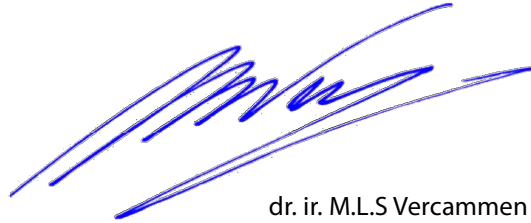


dr. ir. M.L.S Vercammen
Manager

This report contains 13 pages and 11 figures.


PEUTZ bv
Lindenlaan 41, NL-6584 AC MOLENHOEK (LB), THE NETHERLANDS

OVERVIEW

Story

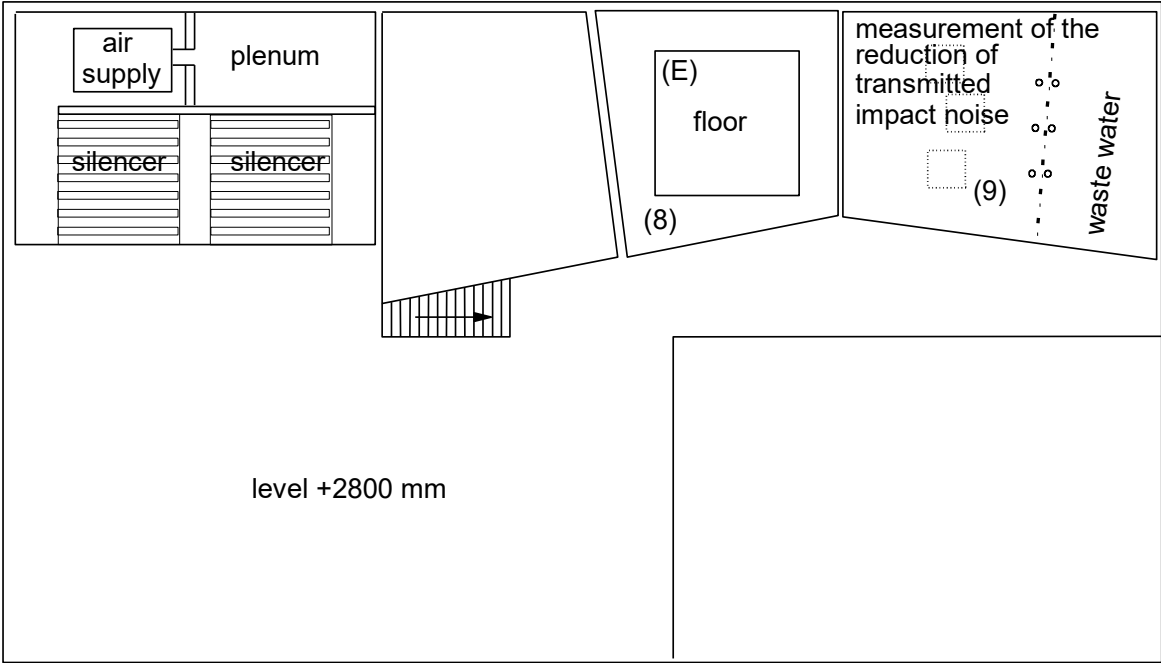


Ground level

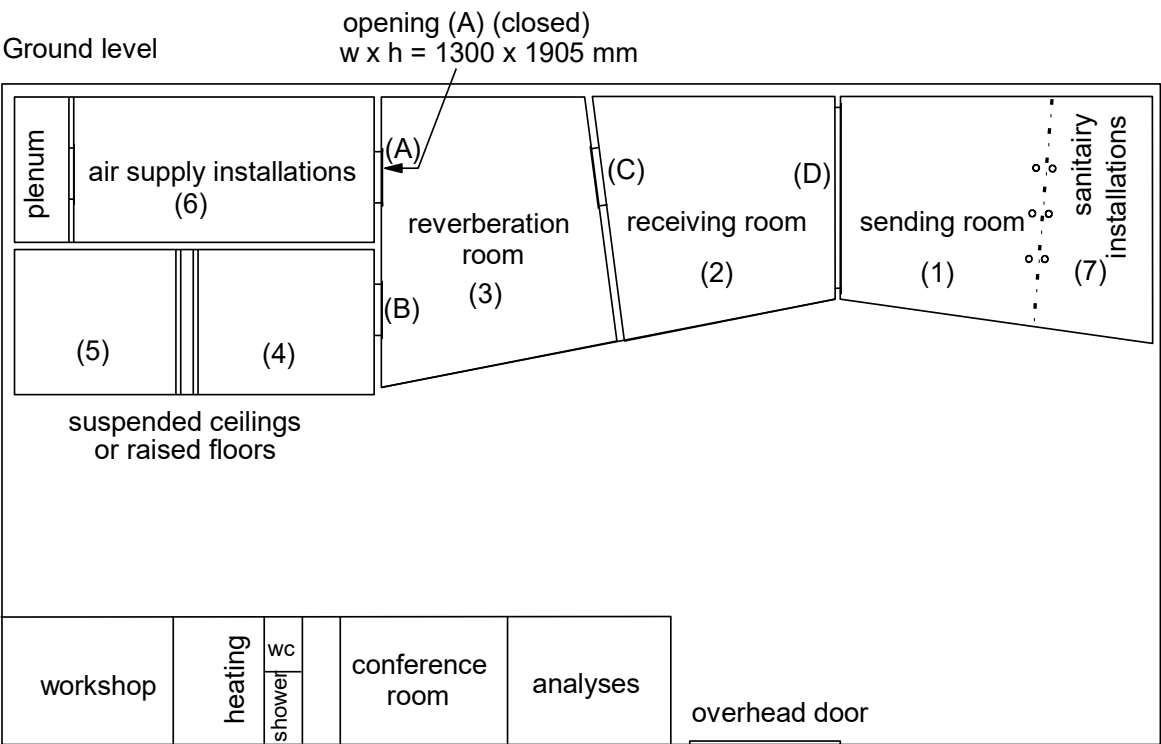

TEST OPENINGS (w x h in mm)

- (B) 1000 x 2200
- (C) 1500 x 1250
- (D) 4300 x 2800
- (E) 4000 x 4000



PEUTZ bv
Lindenlaan 41, 6584 AC MOLENHOEK (LB)

REVERBERATION ROOM

The reverberation room meets the requirements of ISO 354:2003.

additional data:

volume : 214 m³
total area St (walls, floor and ceiling) : 219 m²

diffusion: by the shape of the room and by adding 6 curved and 2 flat reflecting elements with a total area of approx. 13 m² a sufficient diffusion has been gained.


reverberation time of the empty reverberation room during measurements of 23-06-2020

frequency (1/1 oct.)	125	250	500	1000	2000	4000	Hz
reverberationtime	8,44	7,31	6,91	6,43	4,86	3,08	sec.

repeatability r (1/1 oct.) c.f. ISO 354:1985 annex C (see chapter 4.2 of this report).

r at high α	0,13	0,04	0,04	0,02	0,02	0,08	-
r at low α	0,09	0,02	0,01	0,02	0,02	0,04	-

plan

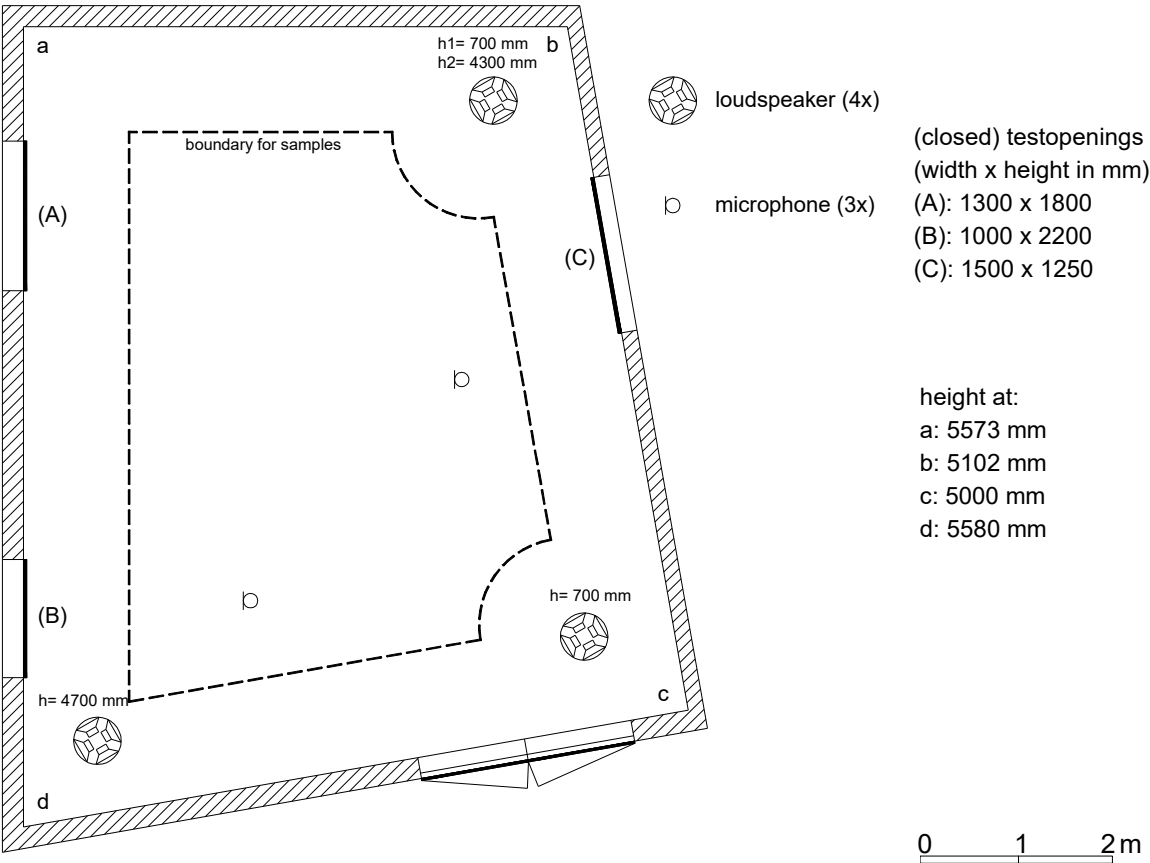



Absorb, versie 5.9 mode 7, file: a3740 E#:1-36 T₁ = 21,6 °C p₁ = 102,3 kPa h₁ = 52,3 %

MEASUREMENT OF SOUND ABSORPTION IN A REVERBERATION ROOM
ACCORDING TO ISO 354:2003



principal: Beterplast LTD

Variant 1: Echoshape, $t = 9\text{ mm}$, $\text{gap} = 0\text{ mm}$

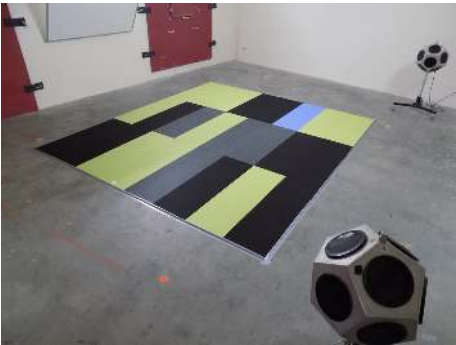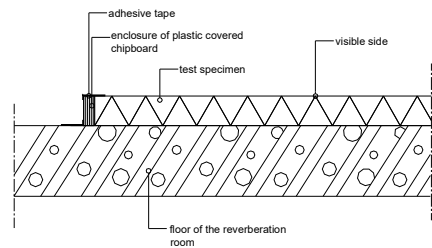

volume reverberation room: 214 m^3

surface area sample: $11,52\text{ m}^2$

height of the construction: 9 mm


measured at: Peutz Laboratory for Acoustics

signal: broad-band noise

bandwidth: 1/3 octave

α_w (ISO 11654) = 0,25(H)

SAA (ASTM - C423) = 0,30

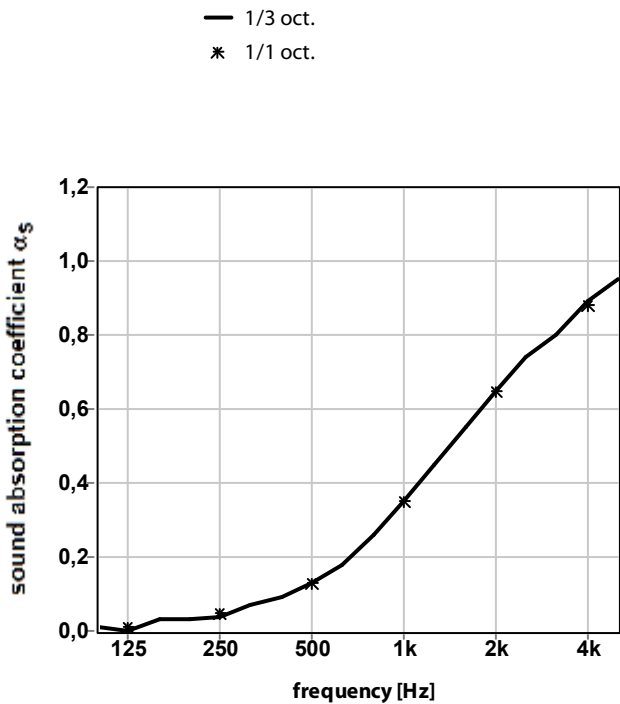

	0,01	0,03	0,09	0,26	0,55	0,80
1/3 oct.	0,00	0,04	0,13	0,35	0,65	0,89
	0,03	0,07	0,18	0,45	0,74	0,95
1/1 oct.	0,01	0,05	0,13	0,35	0,65	0,88

publication is permitted for the entire page only

Mook, measured at 23-06-2020

report A 3740-3E-RA

figure 3


Absorb, versie 5.9 mode 7, PM:JK, file: a3740 E#:125-160 A#:161 T₁ = 21,6 °C T₂ = 21,6 °C p₁ = 102,3 kPa p₂ = 102,2 kPa h₁ = 52,3 % h₂ = 52,5 %

MEASUREMENT OF SOUND ABSORPTION IN A REVERBERATION ROOM ACCORDING TO ISO 354:2003



principal: Beterplast LTD

Variant 2: Echoshape, $t = 12 \text{ mm}$, $\text{gap} = 0 \text{ mm}$

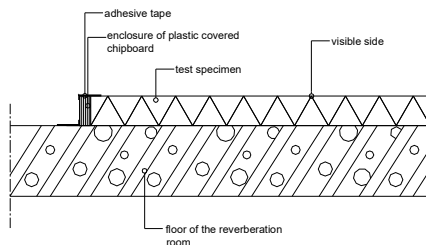

volume reverberation room: 214 m^3

surface area sample: $11,52 \text{ m}^2$

height of the construction: 12 mm

measured at: Peutz Laboratory for Acoustics


signal: broad-band noise

bandwidth: 1/3 octave

α_w (ISO 11654) = 0,25(MH)

SAA (ASTM - C423) = 0,41

— 1/3 oct.
* 1/1 oct.

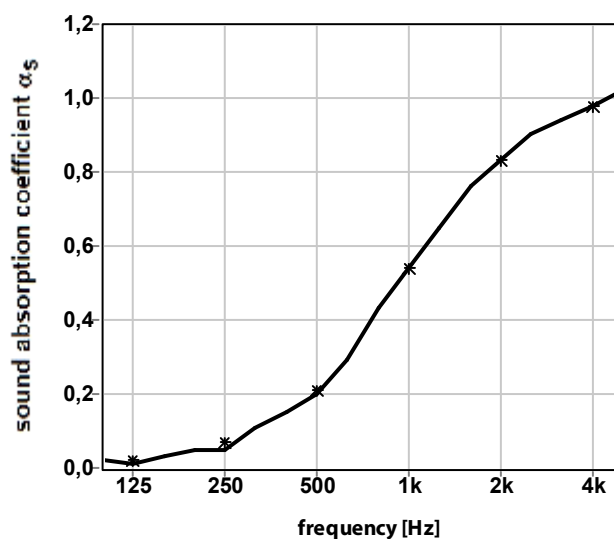

	0,02	0,05	0,15	0,43	0,76	0,94
1/3 oct.	0,01	0,05	0,20	0,54	0,83	0,98
	0,03	0,11	0,29	0,65	0,90	1,02
1/1 oct.	0,02	0,07	0,21	0,54	0,83	0,98

publication is permitted for the entire page only

Mook, measured at 23-06-2020

report A 3740-3E-RA


figure 4

MEASUREMENT OF SOUND ABSORPTION IN A REVERBERATION ROOM
ACCORDING TO ISO 354:2003



principal: Beterplast LTD

Variant 3: Echoshape, $t = 24\text{ mm}$, $\text{gap} = 0\text{ mm}$

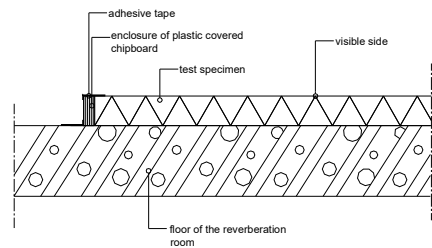

volume reverberation room: 214 m^3

surface area sample: $11,52\text{ m}^2$

height of the construction: 24 mm

measured at: Peutz Laboratory for Acoustics


signal: broad-band noise

bandwidth: 1/3 octave

α_w (ISO 11654) = $0,50(\text{MH})$

SAA (ASTM - C423) = $0,62$

— 1/3 oct.
* 1/1 oct.

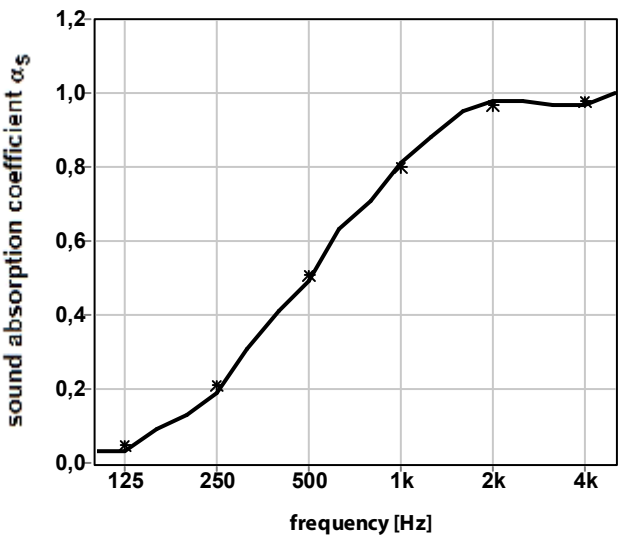

	0,03	0,13	0,41	0,71	0,95	0,97
1/3 oct.	0,03	0,19	0,49	0,81	0,98	0,97
	0,09	0,31	0,63	0,88	0,98	1,00
1/1 oct.	0,05	0,21	0,51	0,80	0,97	0,98

publication is permitted for the entire page only

Mook, measured at 23-06-2020

report A 3740-3E-RA



figure 5

MEASUREMENT OF SOUND ABSORPTION IN A REVERBERATION ROOM ACCORDING TO ISO 354:2003



principal: Beterplast LTD

Variant 4: Echoshape, $t = 9 \text{ mm}$, $\text{gap} = 50 \text{ mm}$

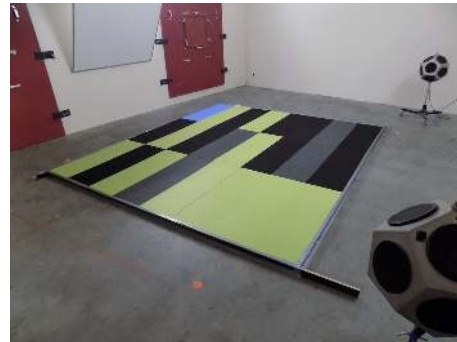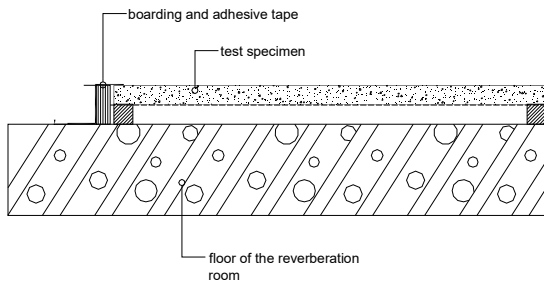

volume reverberation room: 214 m^3

surface area sample: $11,52 \text{ m}^2$

height of the construction: 59 mm


measured at: Peutz Laboratory for Acoustics

signal: broad-band noise

bandwidth: 1/3 octave

α_w (ISO 11654) = **0,55(MH)**

SAA (ASTM - C423) = 0,69

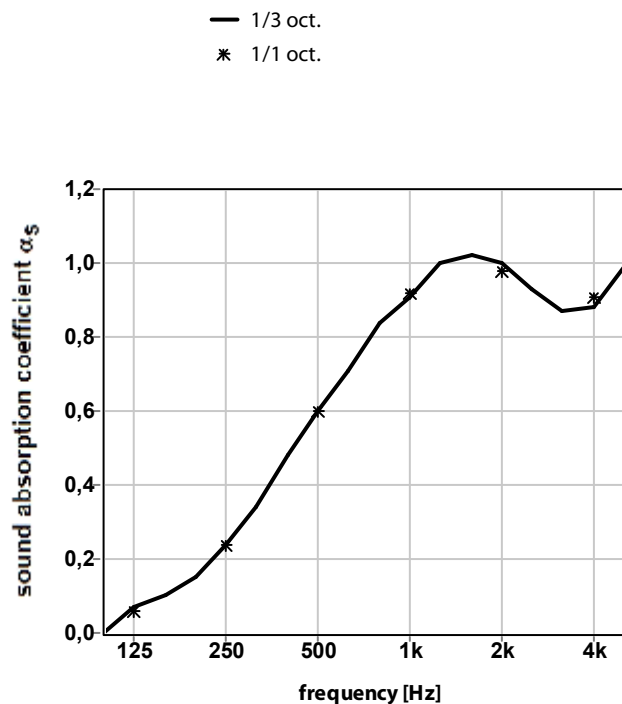

	0,00	0,15	0,48	0,84	1,02	0,87
1/3 oct.	0,07	0,24	0,60	0,91	1,00	0,88
	0,10	0,34	0,71	1,00	0,93	0,99
1/1 oct.	0,06	0,24	0,60	0,92	0,98	0,91

publication is permitted for the entire page only

Mook, measured at 24-06-2020

report A 3740-3E-RA

figure 6



Absorb, versie 5.9 mode 7, PM: JK, file: a3740 E#:162-197 F#:383-418 A#:419 T₁ = 21,9 °C T₂ = 21,9 °C p₁ = 102,0 kPa p₂ = 101,9 kPa h₁ = 49,9 % h₂ = 52,1 %

MEASUREMENT OF SOUND ABSORPTION IN A REVERBERATION ROOM ACCORDING TO ISO 354:2003



principal: Beterplast LTD

Variant 5: Echoshape, $t = 12$ mm, gap = 50 mm

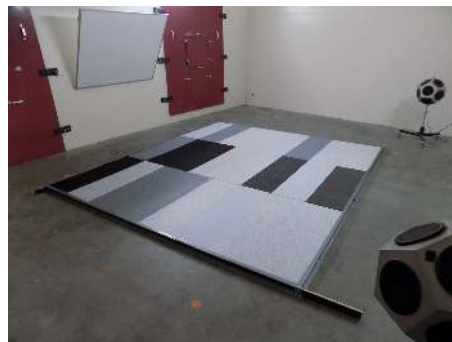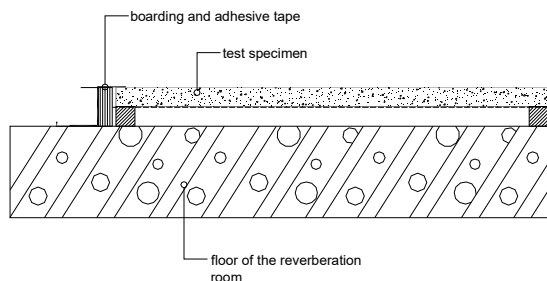

volume reverberation room: 214 m^3

surface area sample: $11,52 \text{ m}^2$

height of the construction: 62 mm

measured at: Peutz Laboratory for Acoustics


signal: broad-band noise

bandwidth: 1/3 octave

α_w (ISO 11654) = 0,60(MH)

SAA (ASTM - C 423) = 0,73

— 1/3 oct.
* 1/1 oct.

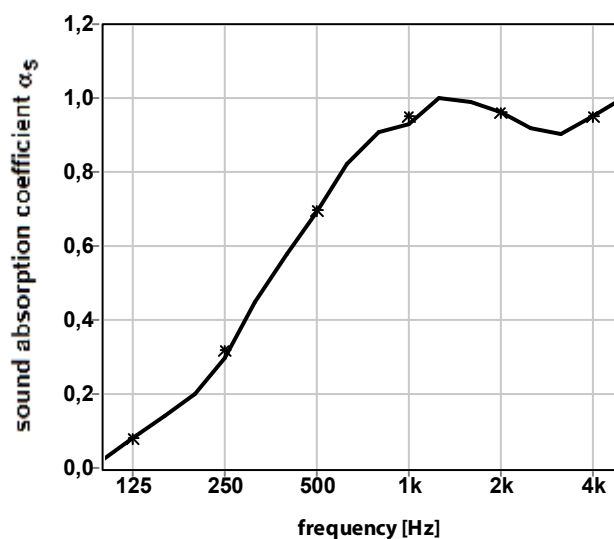

	0,02	0,20	0,58	0,91	0,99	0,90
1/3 oct.	0,08	0,30	0,69	0,93	0,96	0,95
	0,14	0,45	0,82	1,00	0,92	1,00
1/1 oct.	0,08	0,32	0,70	0,95	0,96	0,95

publication is permitted for the entire page only

Mook, measured at 24-06-2020

report A 3740-3E-RA

figure 7


Absorb, versie 5.9 mode 7, PM: JK, file: a3740 E#:162-197 F#:346-381 A#:382 T₁ = 21,9 °C T₂ = 21,9 °C p₁ = 102,0 kPa p₂ = 101,9 kPa h₁ = 49,9 % h₂ = 52,0 %

MEASUREMENT OF SOUND ABSORPTION IN A REVERBERATION ROOM
ACCORDING TO ISO 354:2003



principal: Beterplast LTD

Variant 6: Echoshape, $t = 24\text{ mm}$, $\text{gap} = 50\text{ mm}$

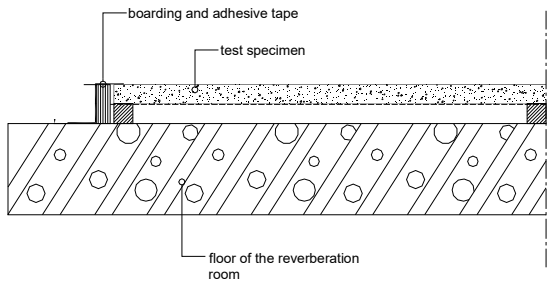

volume reverberation room: 214 m^3

surface area sample: $11,52\text{ m}^2$

height of the construction: 74 mm

measured at: Peutz Laboratory for Acoustics


signal: broad-band noise

bandwidth: 1/3 octave

α_w (ISO 11654) = 0,70(MH)

SAA (ASTM - C 423) = 0,79

— 1/3 oct.
* 1/1 oct.

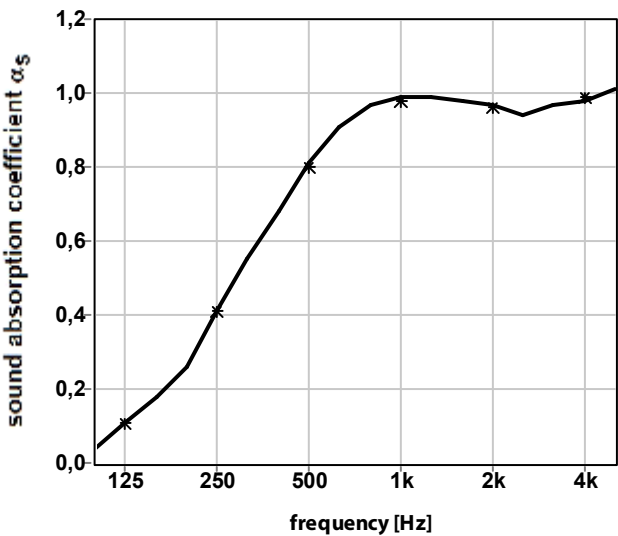

	0,04	0,26	0,68	0,97	0,98	0,97
1/3 oct.	0,11	0,41	0,81	0,99	0,97	0,98
	0,18	0,55	0,91	0,99	0,94	1,01
1/1 oct.	0,11	0,41	0,80	0,98	0,96	0,99

publication is permitted for the entire page only

Mook, measured at 24-06-2020

report A 3740-3E-RA

figure 8


Absorb, versie 5.9 mode 7, PM: JK, file: a3740 E#162-197 F#309-344 AH:345 T₁ = 21,9 °C T₂ = 21,9 °C p₁ = 102,0 kPa p₂ = 101,9 kPa h₁ = 49,9 % h₂ = 52,6 %

MEASUREMENT OF SOUND ABSORPTION IN A REVERBERATION ROOM ACCORDING TO ISO 354:2003



principal: Beterplast LTD

Variant 7: Echoshape, $t = 9 \text{ mm}$, $\text{gap} = 200 \text{ mm}$

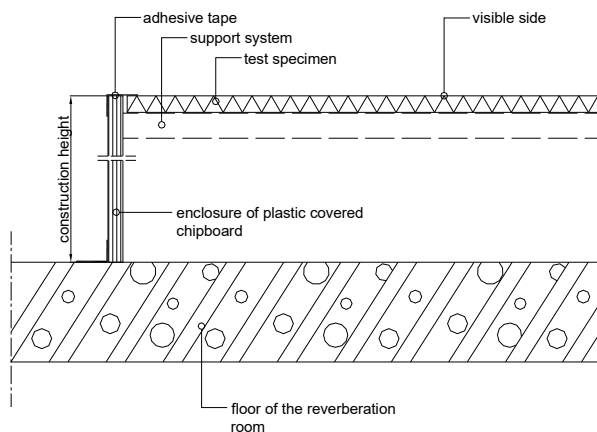

volume reverberation room: 214 m^3

surface area sample: $11,52 \text{ m}^2$

height of the construction: 209 mm

measured at: Peutz Laboratory for Acoustics


signal: broad-band noise

bandwidth: 1/3 octave

α_w (ISO 11654) = 0,85

SAA (ASTM - C423) = 0,80

— 1/3 oct.
* 1/1 oct.

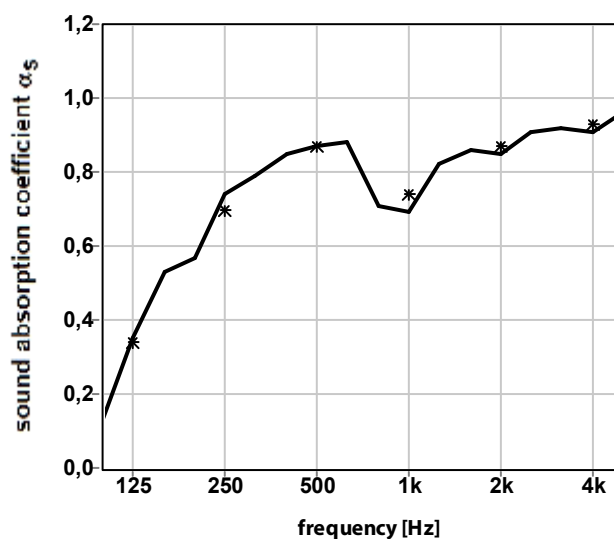

	0,13	0,57	0,85	0,71	0,86	0,92
1/3 oct.	0,35	0,74	0,87	0,69	0,85	0,91
	0,53	0,79	0,88	0,82	0,91	0,96
1/1 oct.	0,34	0,70	0,87	0,74	0,87	0,93

publication is permitted for the entire page only

Mook, measured at 24-06-2020

report A 3740-3E-RA

figure 9


Absorb, versie 5.9 mode 7, PM: JK, file: a3740 E#:162-197 F#:198-233 A#:234 T₁ = 21,9 °C T₂ = 21,9 °C p₁ = 102,0 kPa p₂ = 101,9 kPa h₁ = 49,9 % h₂ = 53,0 %

MEASUREMENT OF SOUND ABSORPTION IN A REVERBERATION ROOM
ACCORDING TO ISO 354:2003



principal: Beterplast LTD

Variant 8: Echoshape, $t = 12\text{ mm}$, $\text{gap} = 200\text{ mm}$

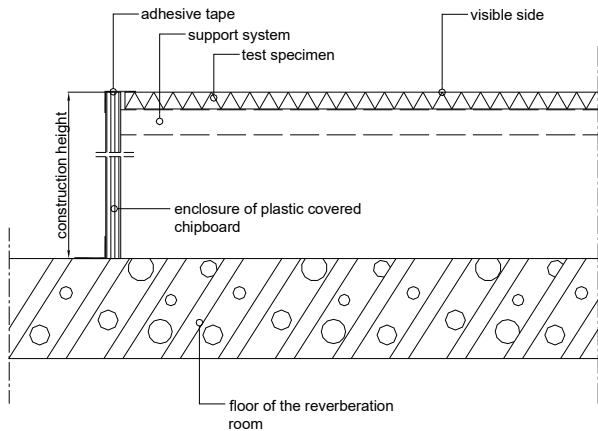

volume reverberation room: 214 m^3

surface area sample: $11,52\text{ m}^2$

height of the construction: 212 mm


measured at: Peutz Laboratory for Acoustics

signal: broad-band noise

bandwidth: 1/3 octave

α_w (ISO 11654) = 0,90

SAA (ASTM - C423) = 0,83

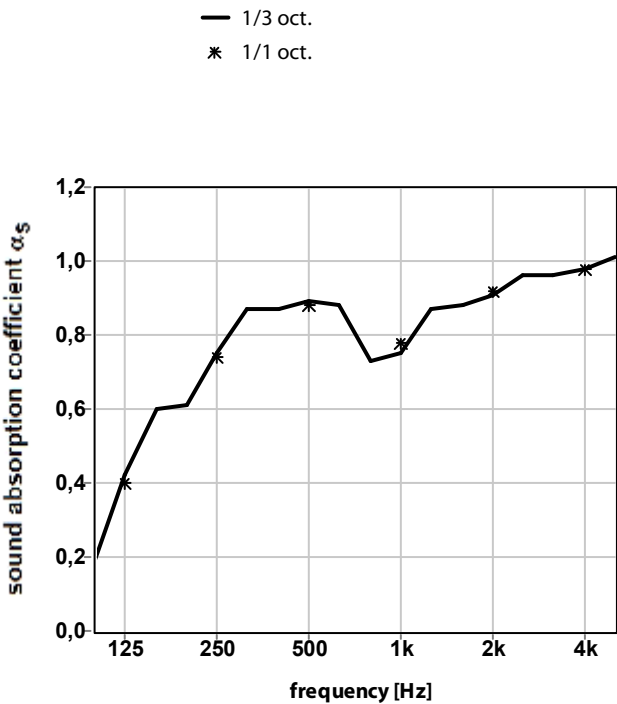

	0,19	0,61	0,87	0,73	0,88	0,96
1/3 oct.	0,42	0,75	0,89	0,75	0,91	0,98
	0,60	0,87	0,88	0,87	0,96	1,01
1/1 oct.	0,40	0,74	0,88	0,78	0,92	0,98

publication is permitted for the entire page only

Mook, measured at 24-06-2020

report A 3740-3E-RA

figure 10


Absorb, versie 5.9 mode 7, PM: JK, file: a3740 E#:162-197 F#:235-270 A#:271 T₁ = 21,9 °C T₂ = 21,9 °C p₁ = 102,0 kPa p₂ = 101,9 kPa h₁ = 49,9 % h₂ = 54,0 %

MEASUREMENT OF SOUND ABSORPTION IN A REVERBERATION ROOM ACCORDING TO ISO 354:2003



principal: Beterplast LTD

Variant 9: Echoshape, $t = 24$ mm, gap = 200 mm

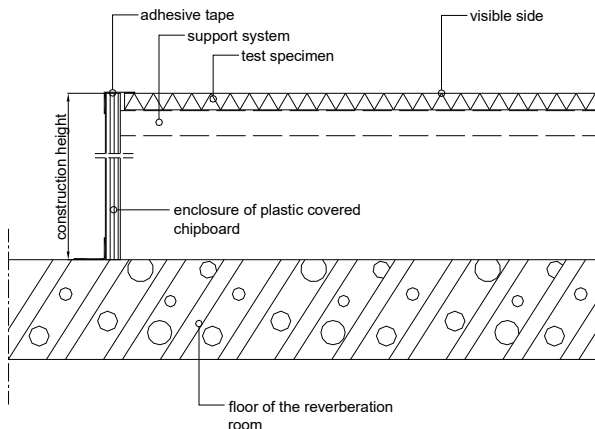

volume reverberation room: 214 m^3

surface area sample: $11,52 \text{ m}^2$

height of the construction: 224 mm

measured at: Peutz Laboratory for Acoustics


signal: broad-band noise

bandwidth: 1/3 octave

α_w (ISO 11654) = 0,90

SAA (ASTM - C423) = 0,87

— 1/3 oct.
* 1/1 oct.

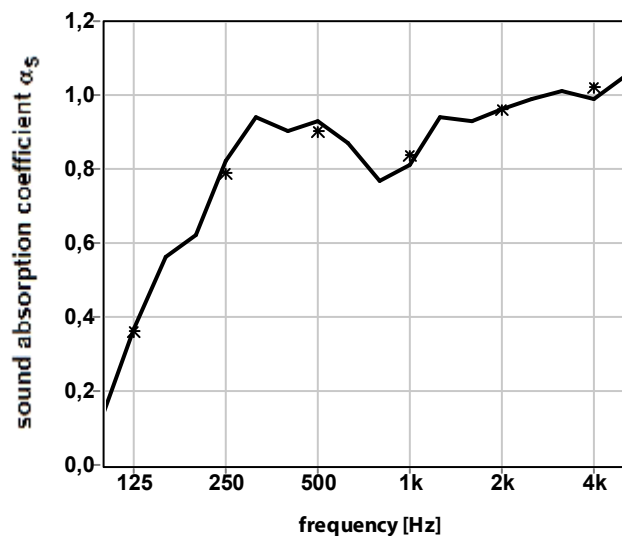

	0,14	0,62	0,90	0,77	0,93	1,01
1/3 oct.	0,37	0,82	0,93	0,81	0,96	0,99
	0,56	0,94	0,87	0,94	0,99	1,05
1/1 oct.	0,36	0,79	0,90	0,84	0,96	1,02

publication is permitted for the entire page only

Mook, measured at 24-06-2020

report A 3740-3E-RA

figure 11

Absorb, versie 5.9 mode 7, PM: JK, file: a3740 E#162-197 F#272-307 A#308 T₁ = 21,9 °C T₂ = 21,9 °C p₁ = 102,0 kPa p₂ = 101,9 kPa h₁ = 49,9 % h₂ = 54,7 %